

NOTICE OF STUDY COMMENCEMENT




STROUD WATER STORAGE FACILITY AND BOOSTER PUMPING STATION MUNICIPAL CLASS ENVIRONMENTAL ASSESSMENT

InnServices Utilities Inc. completed a Master Servicing Plan (MSP) update in 2024 which identified short- and long-term strategies for water and wastewater servicing to accommodate population and employment growth outlined in the Innisfil Official Plan (2018). Under Section 9.2 of the MSP, Recommended Water and Wastewater Master Servicing Plan, the project involving the construction of a New Stroud Water Storage Facility and Booster Pumping Station was suggested for implementation under the short-term timeline.

The proposed Stroud Water Storage Facility and Booster Pumping Station will require a Schedule B Municipal Class Environmental Assessment (MCEA) prior to its construction. This Notice of Commencement is for the proposed new Stroud Water Storage Facility and Booster Pumping Station MCEA to be located on the Yonge Street corridor in the Town of Innisfil. The Water Storage Facility will be supplied by the Lakeshore Water Treatment Plant via the Alcona Reservoir and Booster Pumping Station.

The Stroud Water Storage Facility and Booster Pumping Station study area is proposed to be located on Yonge Street between the 9th Line and Lockhart Road as illustrated on the accompanying map.

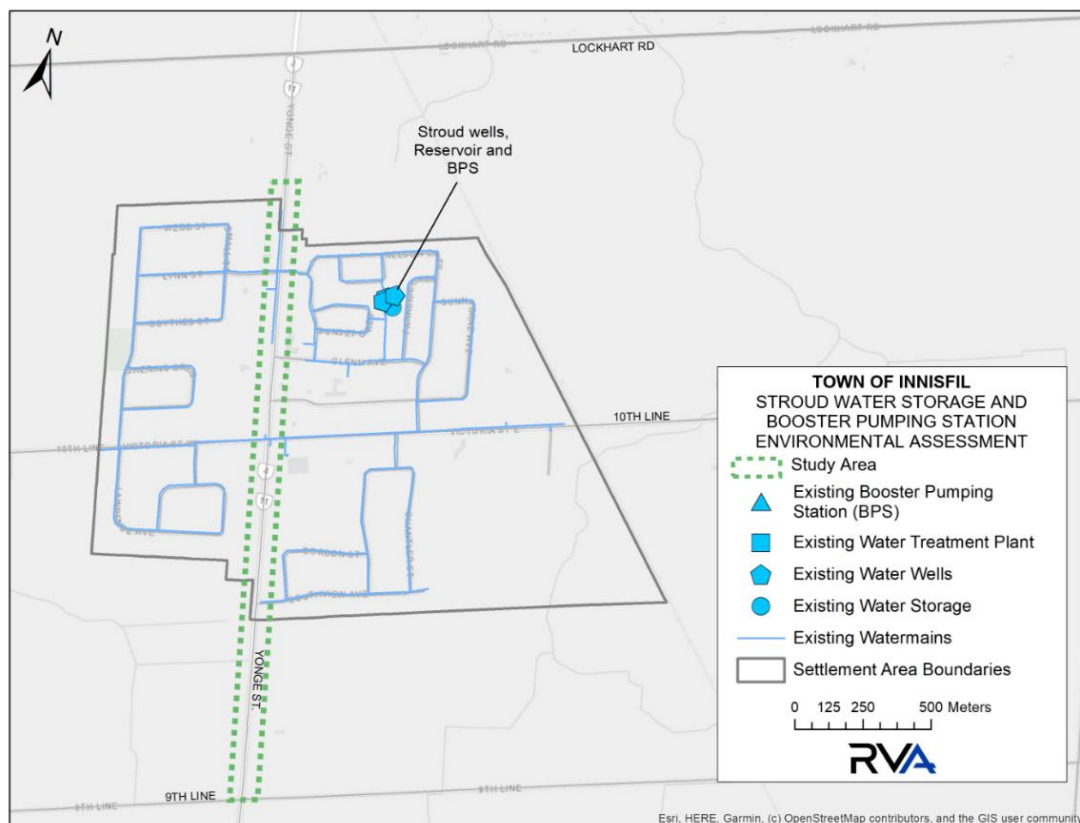

NOTICE OF STUDY COMMENCEMENT



Additional information will be made available once alternatives have been identified and evaluated under Phase 2 of the MCEA. Advance notice will be provided to allow all interested parties an opportunity to comment.

Consultation with the public, Indigenous Communities, regulatory agencies, and interested parties is a key element of a Municipal Class Environmental Assessment study. Anyone who wishes to comment on or be added to the contact list to receive future project notices should indicate their interest, preferably in writing to the following:

Jenna DeGroote, C.E.T.
Capital Project Manager
InnServices Utilities Inc.
jdegroote@innservices.co

Frank Feng, P.Eng.
Environmental Assessment Lead
R.V. Anderson Associates Limited
stroudwaterea@rvanderson.com

Any input received during this process will be maintained on file for use during the project and may be included in project documentation. The information collected will be used in accordance with the Freedom of Information and Protection of Privacy Act. With the exception of personal information, all comments will become part of the public record.

This notice was first issued on August 20, 2025.